


NAME: WOOD/COAL BOILER
 LOCATION: TORRINGTON

4

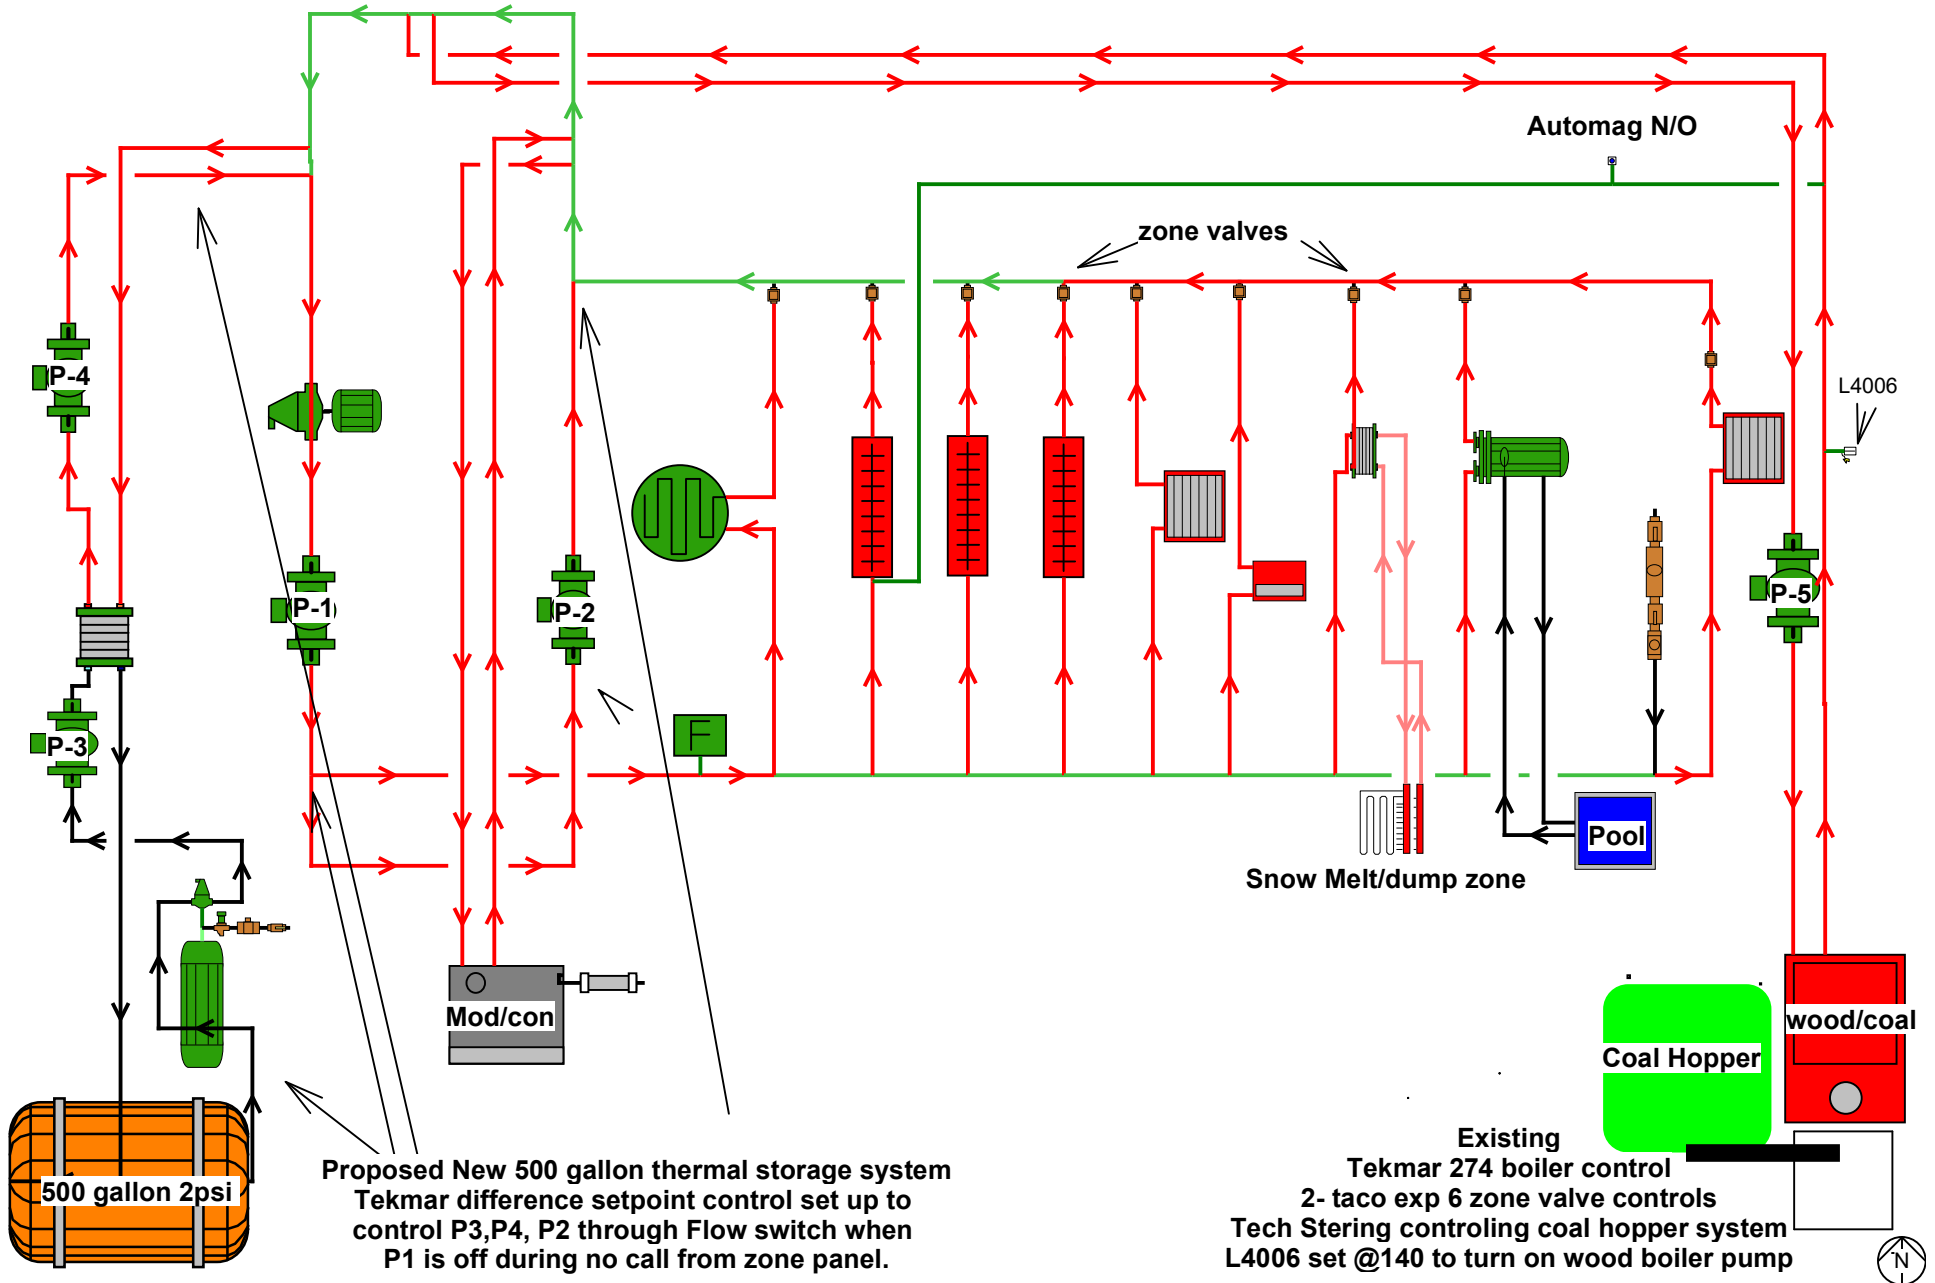

Proposed New 500 gallon thermal storage system
 Tekmar difference setpoint control set up to
 control P3,P4, P2 through Flow switch when
 P1 is off during no call from zone panel.

Existing
 Tekmar 274 boiler control
 2- taco exp 6 zone valve controls
 Tech Sterling controlling coal hopper system
 L4006 set @140 to turn on wood boiler pump

