LOCATION: HOUSE - 3000 FT2

Upper Level

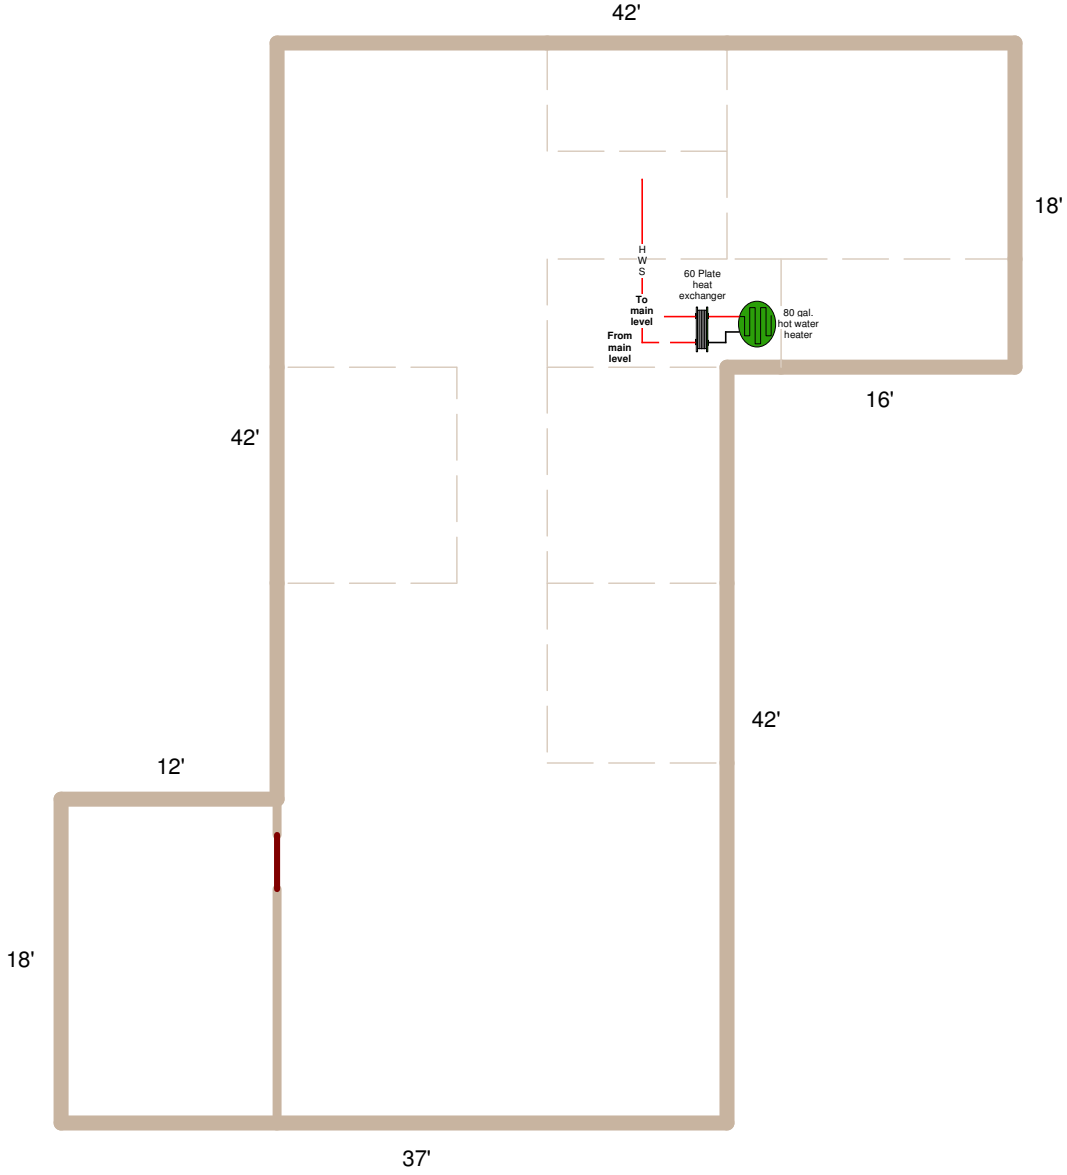

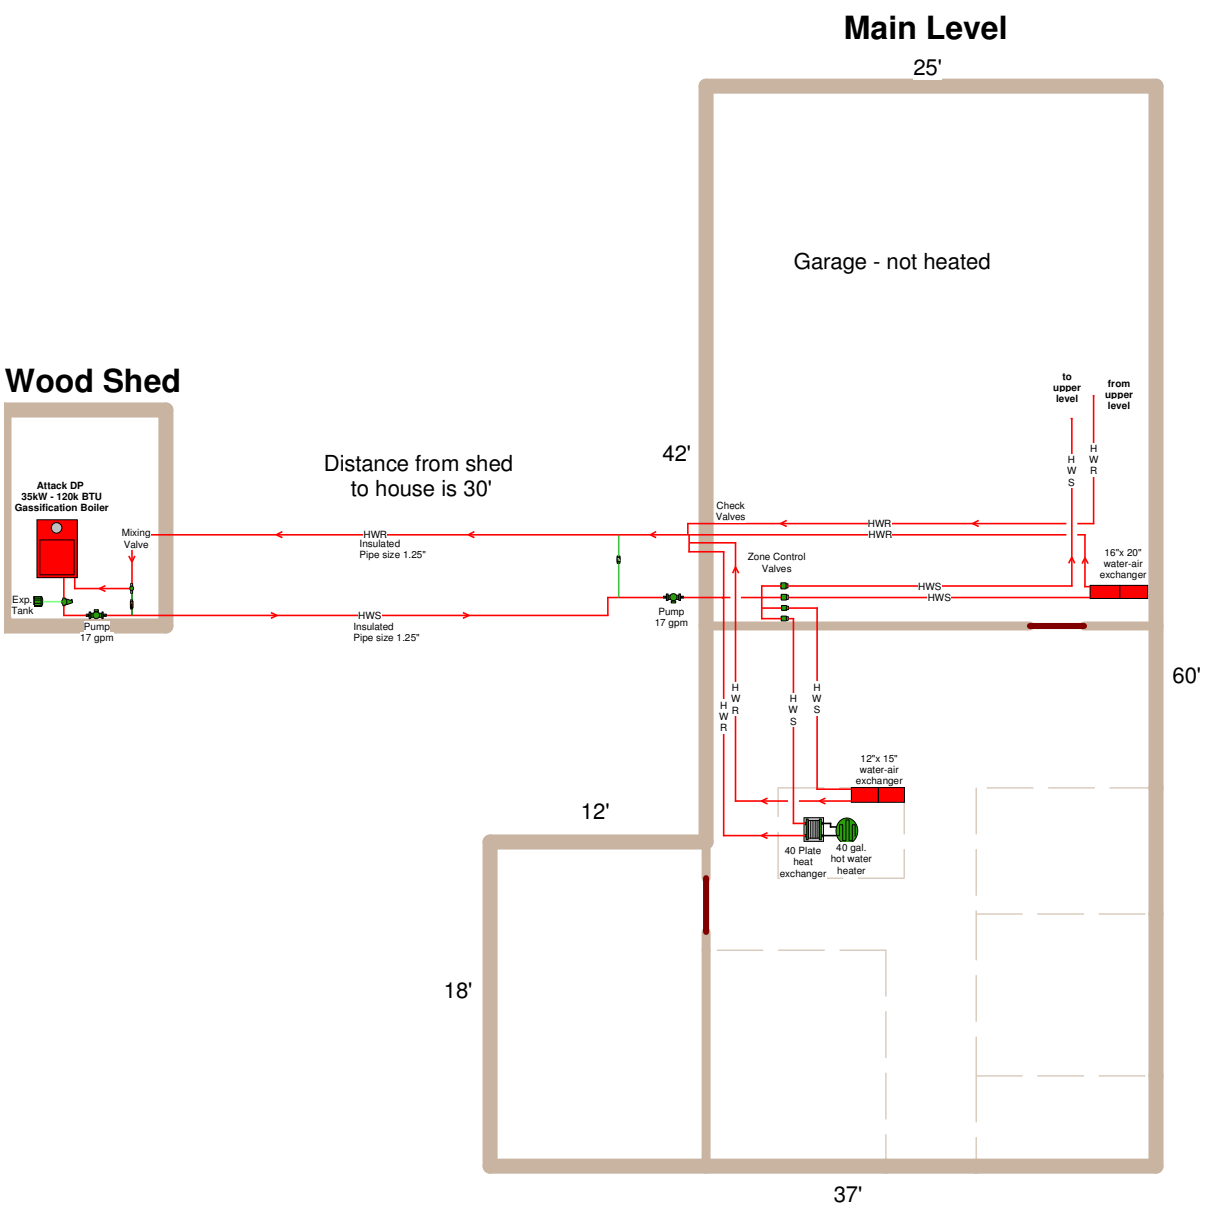
Main Level
25'
Garage - not heated
Wood Shed
Attack DP
35kW - 120k BTU
Gassification Boiler
Mixing
Valve
Exp.
Tank
Pump
17 gpm
Distance from shed
to house is 30'
HWR
Insulated
Pipe size 1.25"
HWS
Insulated
Pipe size 1.25"
42'
Pump
17 gpm
Check
Valves
HWR
HWR
Zone Control
Valves
HWS
HWS
to
upper
level
from
upper
level
HWS
HWR
16"x 20"
water-air
exchanger
60'
HWR
HWR
HWS
HWS
12"x 15"
water-air
exchanger
12'
40 Plate
heat
exchanger
40 gal.
hot water
heater
18'
37'
N