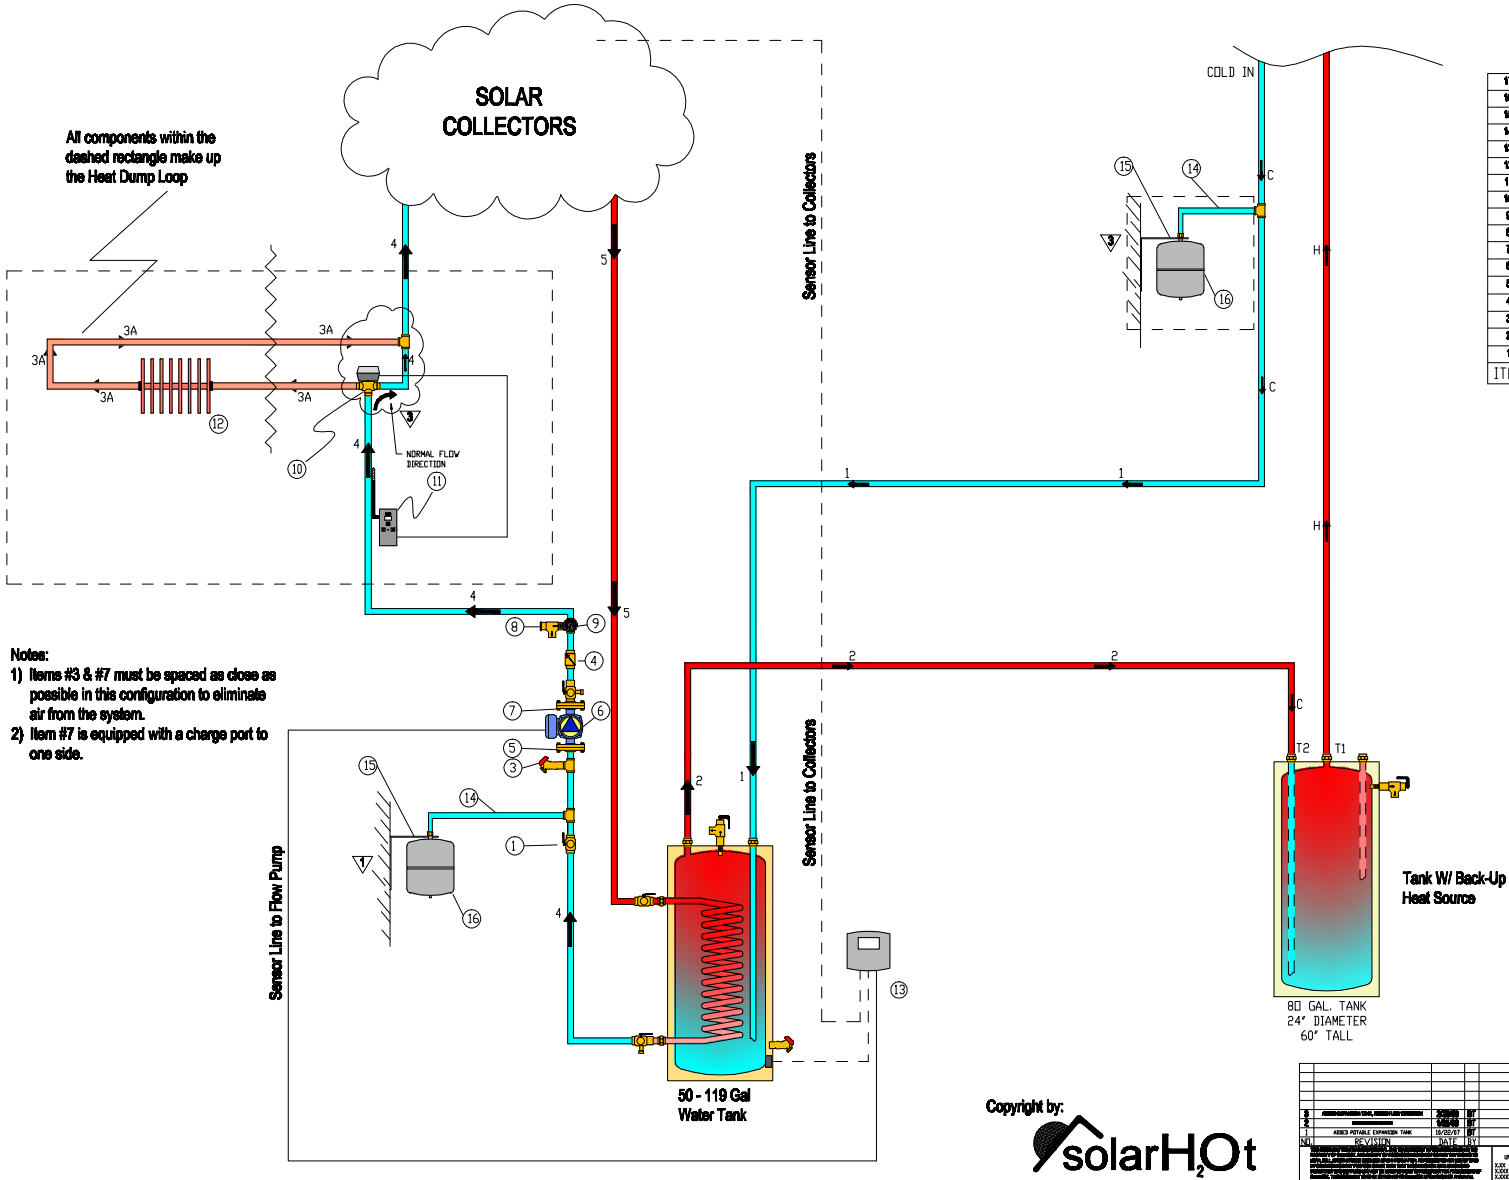

Notes:

1) Items #3 & #7 must be spaced as close as possible in this configuration to eliminate air from the system.
2) Item #7 is equipped with a charge port to one side.

ITEM	DESCRIPTION	QTY
17		
16	Expansion Tank	2
15	Mounting Bracket	2
14	Flex Tube	2
13	Differential Control	1
12	Radiator	1
11	Set Point Controller	1
10	Automatic 3-Way Zone valve	1
9	Pressure Gauge	1
8	Pressure Relief Valve	1
7	Shut Off Flange w/ Charge Port	1
6	Flow Pump	1
5	Pump Flange	1
4	Check Valve	1
3	Drain Valve	1
2	¾" Bronze Tee	3
1	Sweat Ball Valve	1

NO.	REVISION	DATE	BY
3	ADDED EXPANSION TANK, ADDED FLOW CHECKER	2/22/08	BT
2		10/25/07	BT
1	ADDED POTABLE EXPANSION TANK	10/22/07	BT

solarHOt

THIRD ANGLE PROJECTION

TOLERANCES UNLESS OTHERWISE SPECIFIED
X.XX ±0.010
X.XXX ±0.005
X.XXXX ±0.0010
ANGULAR DIM. ±0.25°
CONCENTRICITY 0.005 T.I.R.

DRAWN BY: Bob Thompson
DRAWN DATE: 10/22/07

DESCRIPTION: GLYCOL SYSTEM WITH SINGLE COIL TANK

APPROVED BY
REV: 3
SHEET: 1 OF 1
SCALE: NTS
DWG. SIZE: D
DRAWING NO.: SCHEM0012

Copyright by: solarHOt

SCHEM0012