

C. IPI Battery Tray/Battery Installation

The IntelliFire™ Plus system has a battery backup option. Batteries should only be placed in the battery pack when 110-120 VAC is not available. See Section 2.G.

E. Programming the RC300 to the Control Module

CAUTION! Risk of burns! DO NOT program the remote control to the control module when fireplace is hot.

- Refer to the RC300 Installation Instructions included in appliance manual bag to program the RC300 to the control module.

D. Control Module Operation

See Section 2.H for control module operation instructions.

Note: if any of the original wire as supplied with the appliance must be replaced, it must be replaced with type 105 °C rated wire.

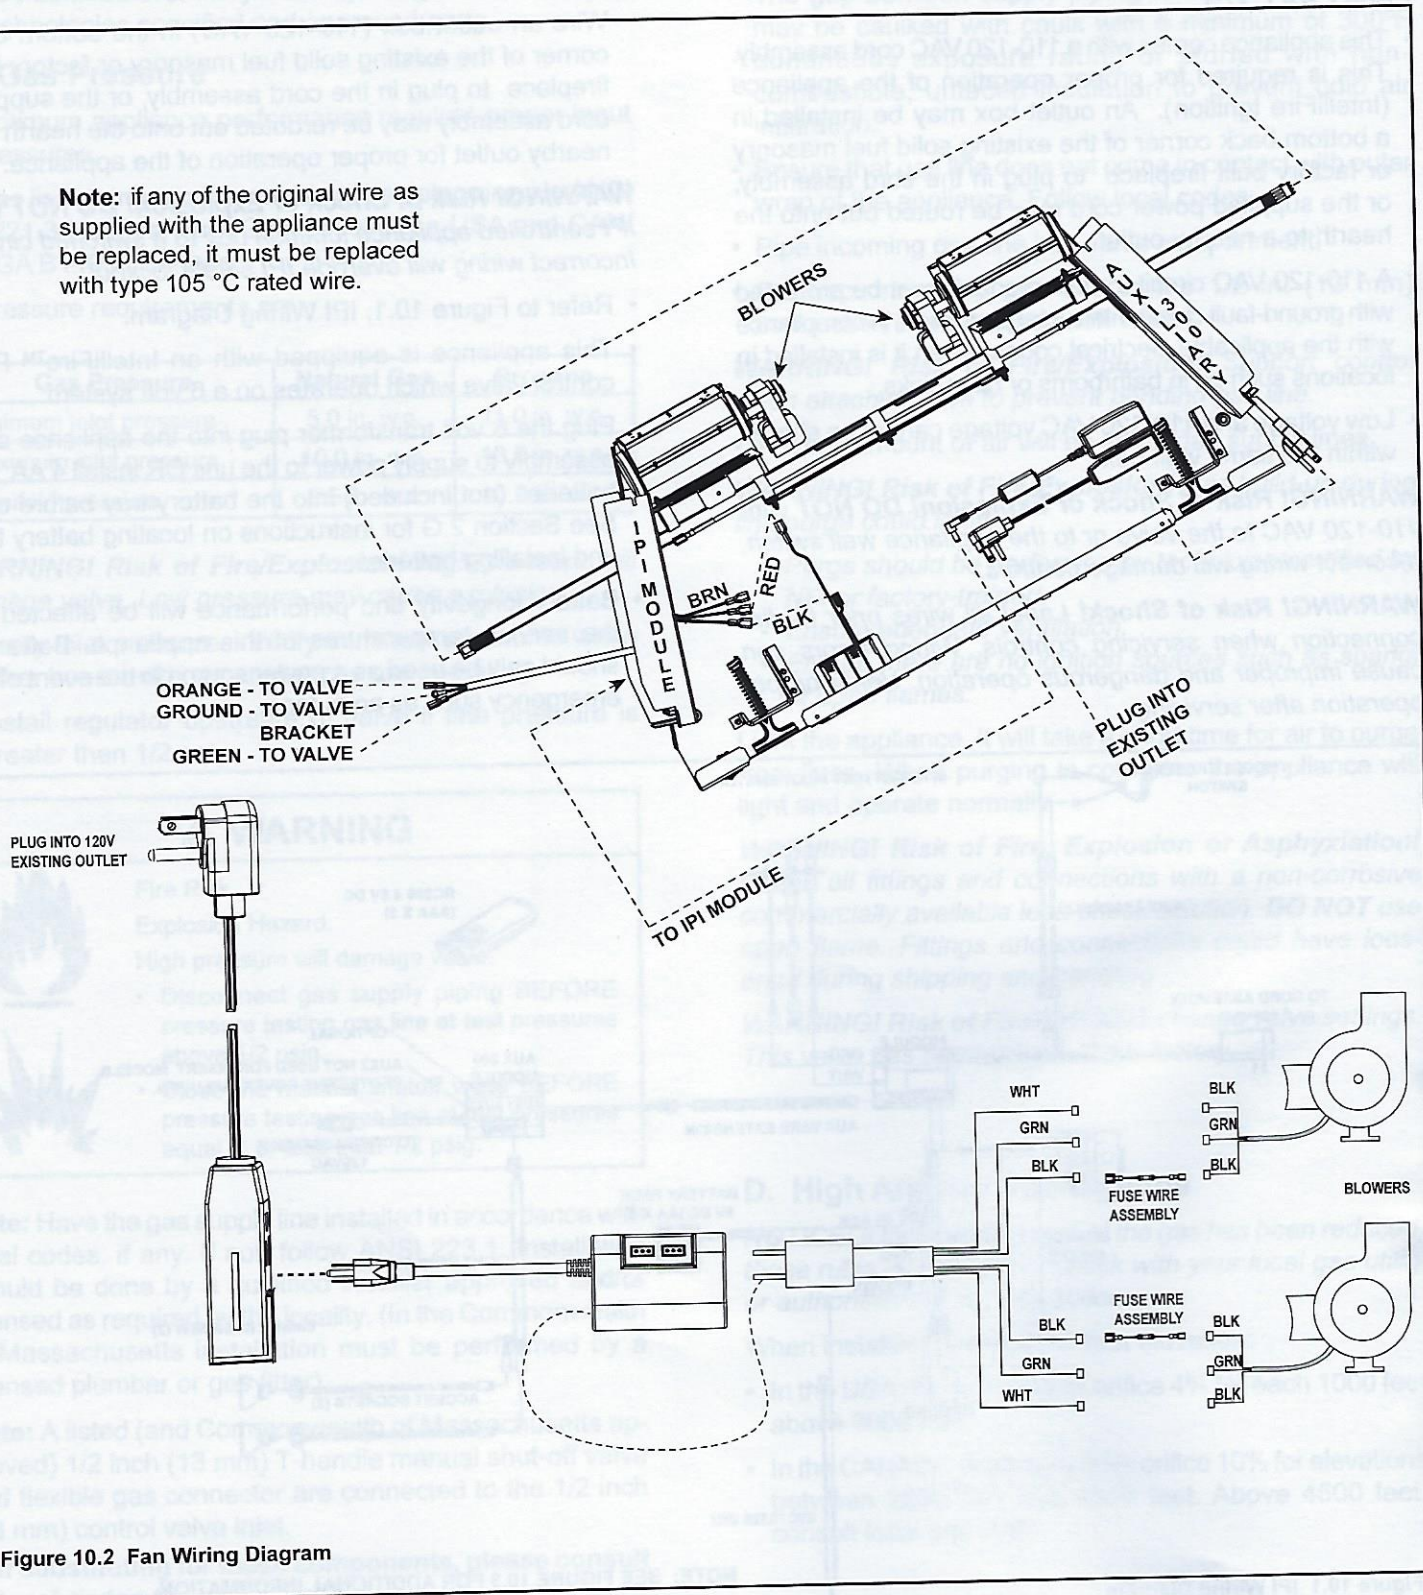


Figure 10.2 Fan Wiring Diagram